


Install printed circuit board with indicator lights facing outwards.

DO NOT connect to 3 phase 480VAC.



Electric Vehicle Infrastructure, Inc.
Auburn, California

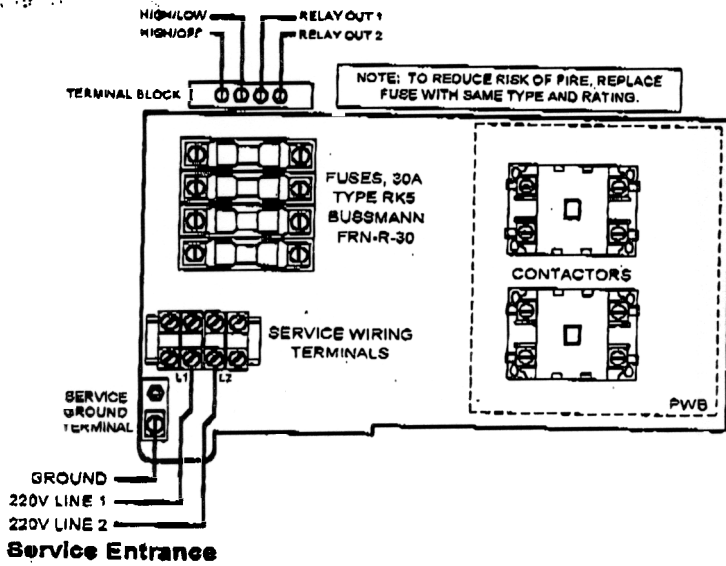

Terminal	Torg, in-lbs
Furnas Contactor	
Fuse Holder	35
Service Wiring Terminals	32
Service Ground Lug	40

Note: For outdoor installation, use watertight hub and compression fitting for connection to conduit.

WARNING

THIS UNIT EMPLOYS PARTS, SUCH AS SWITCHES AND RELAYS, THAT TEND TO PRODUCE ARCS OR SPARKS, AND MUST BE MOUNTED NOT LESS THAN 18 INCHES ABOVE THE FLOOR OF AN ENCLOSED GARAGE.

Install printed circuit board with indicator lights facing outwards.

DO NOT connect to 3 phase 480VAC.



Electric Vehicle Infrastructure, Inc.
Auburn, California